

Sample Received: January 20, 2026

COA Issued: January 21, 2026

PRODUCT INFORMATION

Vendor:
Atomix Research

Sample Name:
Cortagen 20mg

Sample Type:
White lyophilized powder

Lot Number:
NA

MW:
430.4


ANALYTICAL METHODS

Identity: Confirmed via MALDI-MS
Purity: RP-HPLC (214 nm)
Content: HPLC quantitation

TEST RESULTS

Specification	Result	Method	Status
Identity: Cortagen	Cortagen	MALDI-MS	✓ Conforms
Content	20.37 mg	HPLC Quantitation	✓ Conforms
Purity	99.8%	RP-HPLC (214 nm)	✓ Conforms

ANALYTICAL DATA

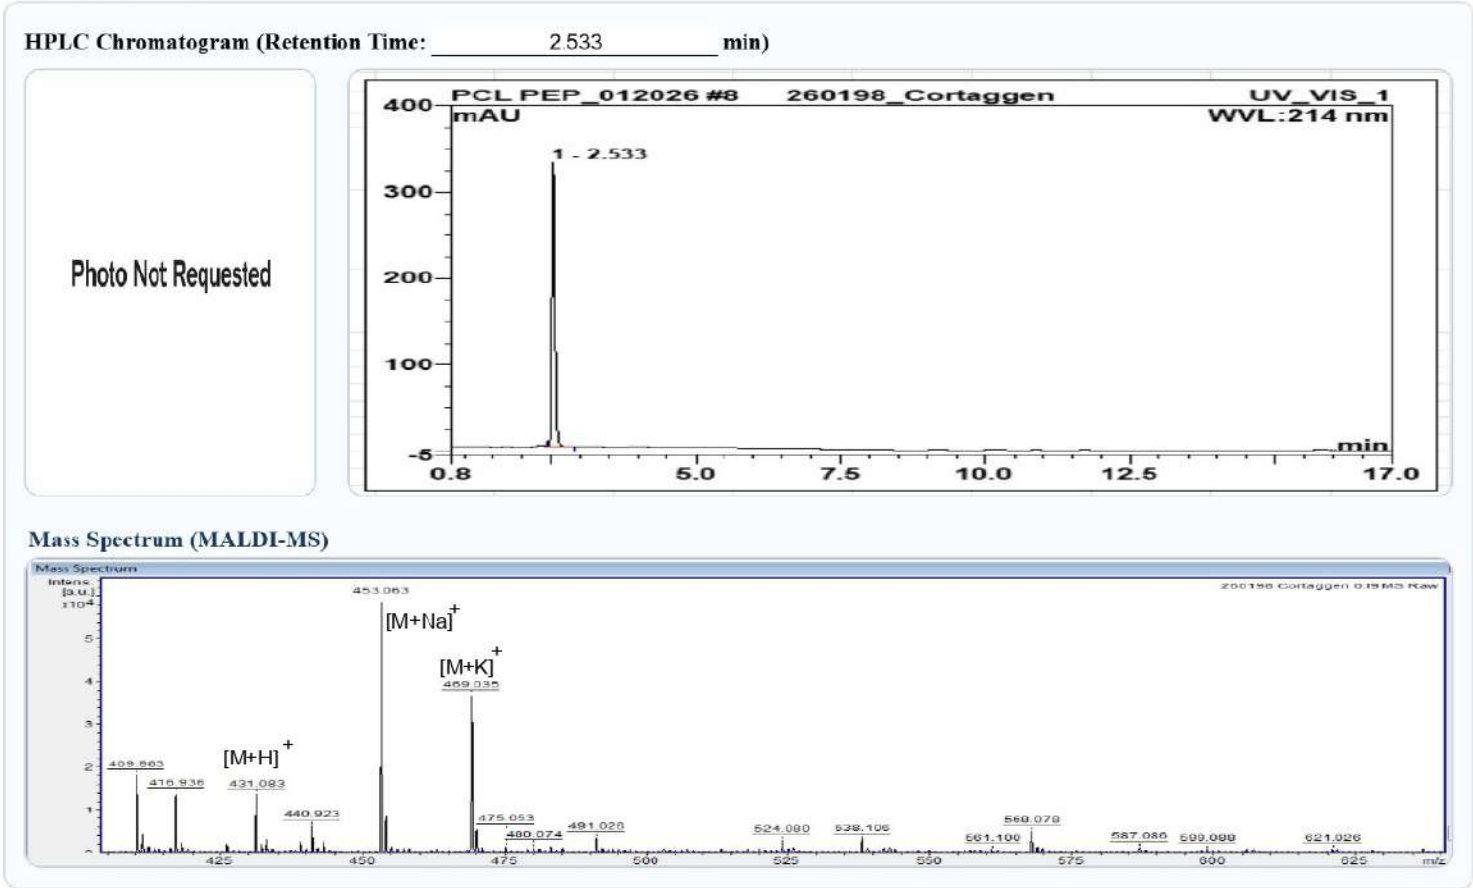

Certification: This COA confirms that the tested material meets or exceeds Bioviridian’s analytical quality specifications for peptide research use.

Visit: <https://bioviridians.com/coa-search.html>



Shane Straight

Shane Straight, M.S.
Principal Chemist, Bioviridian Inc.

Contact: info@bioviridians.com